


FRONT VIEW

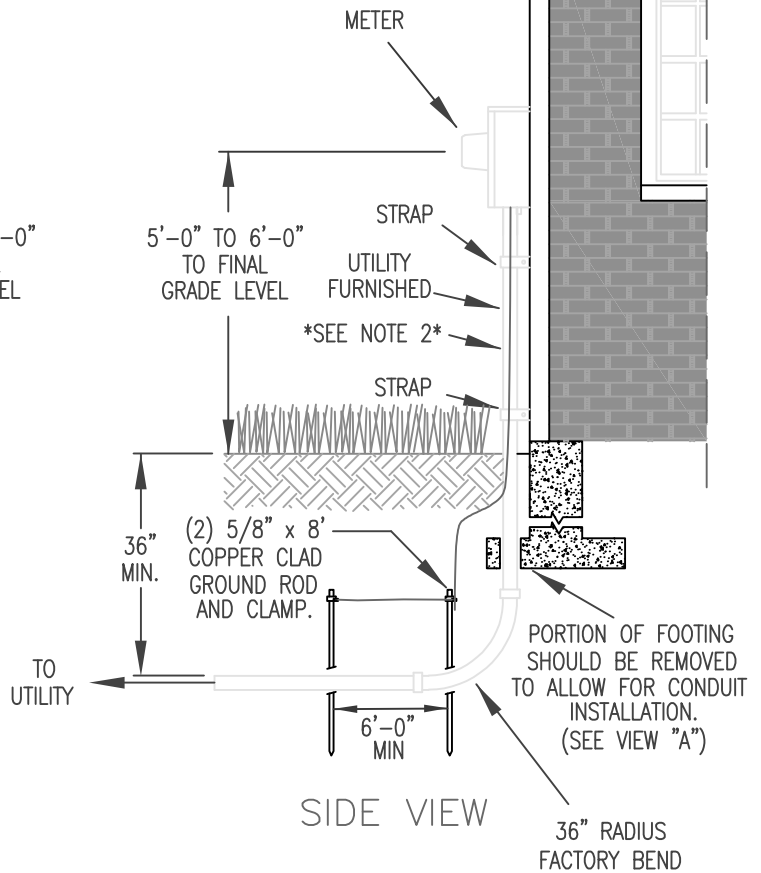

SIDE VIEW

Minimum Conductor Sizes for Standard Service Ratings (Based on NEC Tables 310.15(B)(7), 310.15(B)(16) & 250.66)					
Copper, Aluminum or Copper-Clad Aluminum					
Service Rating (Amperes)	*Ungrounded Conductor (CU) Size	*Grounded (Neutral) Conductor (CU) Size	*Ungrounded Conductor (AL) Size	*Grounded (Neutral) Conductor (AL) Size	*Grounding Electrode & System Bonding Conductor (CU only) Size
100	4 AWG	6 AWG	2 AWG	4 AWG	6 AWG
200	2/0 AWG	1/0 AWG	4/0 AWG	2/0 AWG	4 AWG
320	350 kcmil	4/0 AWG	500 kcmil	350 AWG	1/0 AWG

*Conductor sizes listed are the smaller sizes deemed to be acceptable per NEC Table 310.15(B)(7) for 120/240 Volt, 3-Wire, Single-Phase Dwellings. Other applications refer to NEC Table 310.15(B)(7).

This table is only a guide for some minimum conductor requirements and is not intended to be a comprehensive list of acceptable conductor sizes. The NEC should be reviewed to ensure compliance with all applicable requirements, including but not limited to conductor size, material and insulation type.

The Grounding Electrode Conductor and the System Bonding Conductor shall be Copper.

NOTE:
CONDUIT TYPE AND SIZE AS SPECIFIED BY UTILITY, CUSTOMER FURNISHED.

NOTE 2:
CONDUIT PATH FROM BOTTOM OF METER BASE TO BELOW FOOTING SHALL NOT BE OBSTRUCTED

NOTE 3:
FOOTING SHOULD BE EXPOSED FOR VISUAL INSPECTION BEFORE WORK CAN BE COMPLETED

NOTE 4:
LOCAL CODE AUTHORITIES MAY HAVE REQUIREMENTS IN ADDITION TO THOSE SHOWN.

UNDERGROUND SERVICE TO RESIDENTIAL


DIXIE ELECTRIC POWER ASSOCIATION
LAUREL, MISSISSIPPI

file:
MS30RESUG-2


date:
MARCH 2023

Not to Scale


UNDERGROUND CLEARANCE FOR SWIMMING POOL

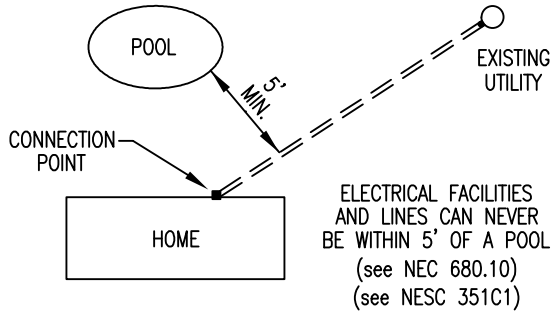


UNDERGROUND REQUIREMENTS FOR PAVED AREAS

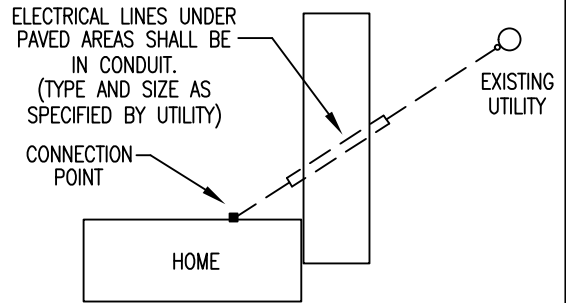


UNDERGROUND FACILITIES CLEARANCES

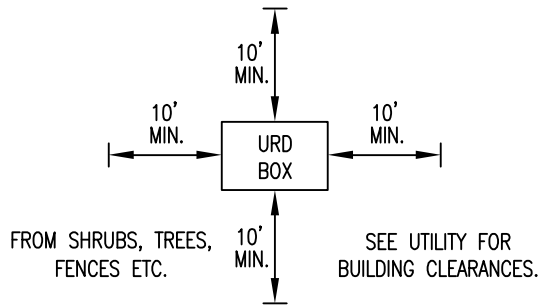

DO NOT BLOCK ACCESS TO UTILITY'S FACILITIES

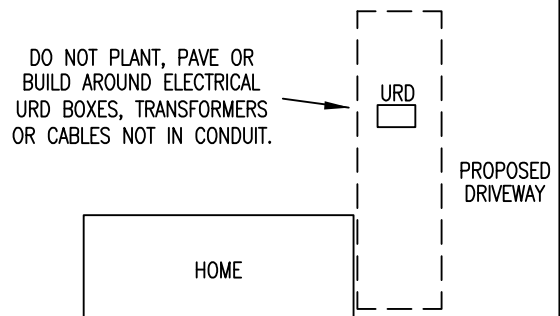

METER CLEARANCES

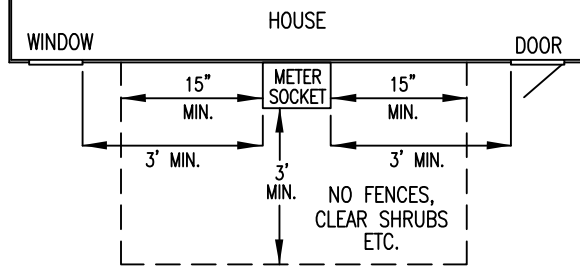


FOR RESIDENTIAL SERVICE, THE METER IS TO BE LOCATED ON THE OUTSIDE OF THE BUILDING ON THE SIDE OF THE RESIDENCE WITHIN THREE FEET OF THE FRONT WALL AND OUTSIDE OF THE FENCES ON THE SIDE MOST ECONOMICAL TO REACH THE UTILITY'S FACILITIES.

CAUTION:
NO GAS METERS WITHIN 3' RADIUS OF METER ENCLOSURE.

LOCAL CODE AUTHORITIES MAY HAVE REQUIREMENTS IN ADDITION TO THOSE SHOWN.

PLACE TEMPORARY UNDERGROUND SERVICE WIRE HERE (UNDERGROUND 36" DEEP)

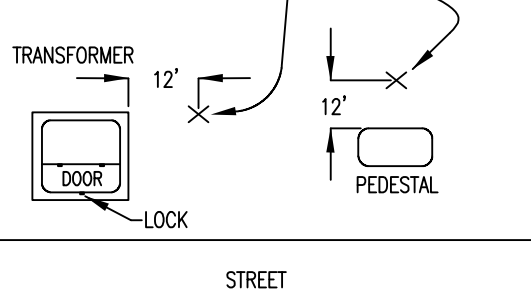

NOTE: 15 FOOT BOUNDARY LINE TO NEAREST POWER LINE CONDUCTOR. THE ONLY LINES THAT MAY ENTER THIS ZONE IS THE SERVICE CABLE TO THE METER POLE.

NO ELECTRIC WIRES ARE PERMITTED TO CROSS OVER MOBILE HOME. MOBILE HOMES ARE NOT PERMITTED TO BE INSTALLED UNDER ELECTRIC LINES.

CLEARANCE REQUIREMENTS FOR RESIDENTIAL UNDERGROUND SERVICE

DIXIE ELECTRIC POWER ASSOCIATION
LAUREL, MISSISSIPPI

file:
MS30RESUGLOC

date:
MAY 2013

Not to Scale